

NEENAH-MENASHA SEWERAGE COMMISSION

ORDINANCE NO. 2014-1

AN ORDINANCE TO AUTHORIZE CHANGES TO NMSC INDUSTRIAL PRETREATMENT RULES AND REGULATIONS OF THE NEENAH-MENASHA SEWERAGE COMMISSION (ENACTED PURSUANT TO ITS AUTHORITY UNDER WISCONSIN STATUTES, SECTION 66.0301, AS AMENDED, AND ITS ENABLING ORDINANCE /CONTRACT, DATED 9- 28-1982, AS AMENDED, AMONG SEVERAL WISCONSIN MUNICIPALITIES WHICH JOINTLY RECREATED SAID COMMISSION) AMENDING SPECIFIC INDUSTRIAL PRETREATMENT RULES AND REGULATIONS.

WHEREAS, the Neenah-Menasha Sewerage Commission is required to enact, maintain and enforce industrial pretreatment rules and regulations in compliance with federal and state laws and regulations; and, accordingly, had previously enacted NMSC Ordinance No. 84-6, on October 9, 1984, amended by NMSC ordinance number 88-1, on March 2, 1988, and further amended by NMSC ordinance number 90-1, on February 26, 1991, and further amended by NMSC Ordinance No. 94-1 on April 26, 1994;

NOW, THEREFORE, the Neenah-Menasha Sewerage Commission does hereby amend the current status of each of the foregoing ordinances by replacing the provisions of the same by enacting this amendatory ordinance to ordain the following new industrial pretreatment and rules and regulations, as approved by the state of Wisconsin, Department of Natural Resources, by letter to the NMSC dated January 8, 2014 (attached hereto and incorporated herein as a fully set forth), to wit:

An Amendment to the Neenah-Menasha Sewerage Commission's Industrial Pretreatment Rules and Regulations existing as NMSC Ordinance 94-1:

Chapter 3, Section 3.03 (C) (1) is changed to read:

C. NMSC Local Limitations.

1. Local Metal Limits. No discharger shall discharge wastewater containing concentrations and/or mass limitations of the following enumerated materials exceeding the following values:

| Material         | Concentration<br>(milligrams/liter) |
|------------------|-------------------------------------|
| Cadmium (total)  | 0.558                               |
| Chromium (total) | 15.4                                |
| Copper (total)   | 3.56                                |
| Mercury (total)  | 0.0006                              |

(0.0006 mg/L is advisory only the NMSC may allocate the maximum allowable mercury loading (lbs/day) among its sewer users as it deems appropriate.)

The Commission may impose specific mass limitations on Dischargers where deemed appropriate by the Commission.

Chapter 3, Section 3.03 (C) (2) (a) is changed to read:

- 2. Local pH Limitations.
  - a. Limitation. All discharges shall meet a pH range not less than 5.0 minimum and not more than 11.0 maximum.

IN WITNESS WHEREOF, the NMSC has caused this ordinance to be enacted and to be signed and attested to by its duly authorized officers. This ordinance shall become effective on the date its publication.


Passed and adopted by the NMSC, Winnebago County, State of Wisconsin, February, 25, 2014.

Ayes:   5  


Nays:   0  

NEENAH-MENASHA SEWERAGE COMMISSION

By:

  
\_\_\_\_\_  
Dale Youngquist, President

By:

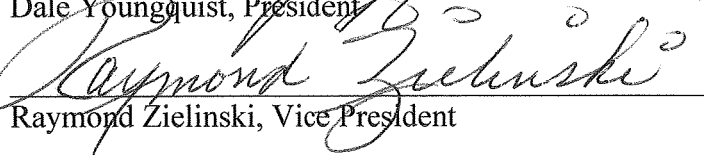  
\_\_\_\_\_  
Raymond Zielinski, Vice President


State of Wisconsin  
DEPARTMENT OF NATURAL RESOURCES  
101 S. Webster Street  
Box 7921  
Madison WI 53707-7921

Scott Walker, Governor  
Cathy Stepp, Secretary  
Telephone 608-266-2621  
Toll Free 1-888-936-7463  
TTY Access via relay - 711



January 8, 2014

Mr. Dale Youngquist  
President  
Neenah Menasha Sewerage Commission  
101 Garfield Ave.  
Menasha, WI, 54952-3397

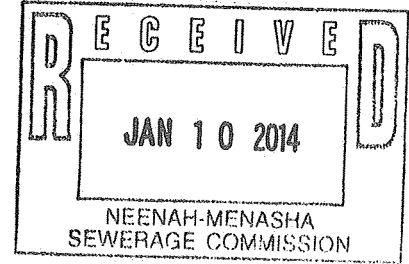

Subject: DNR Approval of Revised Local Limits for the Neenah Menasha Sewerage Commission

Dear Mr. Youngquist:

The Department has reviewed changes to the Neenah Menasha Sewerage Commission's (NMSC) Sewer Use Ordinance first submitted to the Department on August 28, 2013. These changes included revised local limits for the NMSC. NMSC made further revisions to the proposed local limits as a result of Department comments. The Department notified the public of these revised local limits in a public notice which appeared in the Appleton Post Crescent on Dec. 4, 2013. Neither the Department nor NMSC received any comments regarding the proposed changes.

The Department hereby approves NMSC's revised local limits as public noticed on Dec. 4, 2013. I request that you provide the Department with a copy of the amended sewer use ordinance with revised local limits after its publication.

Sincerely,



Robert Liska  
Wisconsin Pretreatment Coordinator  
(608) 267 - 7631  
Wisconsin Department of Natural Resources, WY/3  
101 S. Webster St., P.O. Box 7921  
Madison, WI, 53707 - 7921

cc: Nan Jameson - WDNR Green Bay  
Randall Much - NMSC Wastewater Treatment Plant  
Laurie Stenson - NMSC Wastewater Treatment Plant

This attachment is provided for the historical record to show the DNR approved the changes approved by the Amendment of the Ordinance for pretreatment rules following a public hearing.

Amendment to the Neenah Menasha Sewerage Commission's Industrial Pretreatment Rules and Regulations 94-1

Chapter 3, Section 3.03 (C) (1) is changed to read:

C. NMSC Local Limitations.

1. Local Metal Limits. No discharger shall discharge wastewater containing concentrations and/or mass limitations of the following enumerated materials exceeding the following values:

| <u>Material</u>  | <u>Concentration<br/>(milligrams/liter)</u> |
|------------------|---|
| Cadmium (total)  | 0.558                                       |
| Chromium (total) | 15.4  |
| Copper (total)   | 3.56  |
| Mercury (total)  | 0.0006                                      |

(0.0006 mg/L is advisory only the NMSC may allocate the maximum allowable mercury loading (lbs/day) among its sewer users as it deems appropriate.)

The Commission may impose specific mass limitations on Dischargers where deemed appropriate by the Commission.


Chapter 3, Section 3.03 (C) (2) (a) is changed to read:

2. Local pH Limitations.

- a. Limitation. All discharges shall meet a pH range not less than 5.0 minimum and not more than 11.0 maximum.

# THE POST-CRESCENT

STATE OF WISCONSIN  
OUTAGAMIE COUNTY

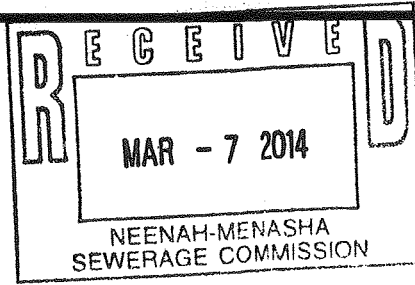

NEENAH MENASHA SEWERAGE COMM  
101 GARFIELD AVE  
MENASHA, WI 549523315

Being duly sworn, doth depose and say that she is an authorized representative of the Appleton Post Crescent, a newspaper published at Appleton, Wisconsin, and that an advertisement of which the annexed is a true copy, taken from said paper, which was published therein on

Account Number: 1019860

**Ad Number: 6944612**

Published Date: March 06, 2014

**Total Ad Cost: \$151.13**

(Signed)

*Macarena Woody*

Advertising Assistant

*3/6/14*

(Date)

Signed and sworn before me

*[Signature]*

Notary Public, Outagamie County, Wisconsin

My commission expires

*3-27-16*

NEENAH MENASHA SEWERAGE COMM

Re Ad#: 6944612

306 W. Washington St. • P.O. Box 59 • Appleton, Wisconsin 54912

(920) 733-4411 • (800) 236-6397 • Advertising Fax (920) 954-1945

NEENAH-MENASHA  
SEWERAGE  
COMMISSION  
ORDINANCE  
NO. 2014-1

AN ORDINANCE TO  
AUTHORIZE CHANGES  
TO NMSC INDUSTRIAL  
PRETREATMENT RULES  
AND REGULATIONS  
OF THE NEENAH-MENASHA  
SEWERAGE COMMISSION  
(ENACTED PURSUANT TO  
ITS AUTHORITY UNDER  
WISCONSIN STATUTES,  
SECTION 66.0301, AS  
AMENDED, AND ITS  
ENABLING ORDINANCE  
/CONTRACT, DATED 9-28-  
1982, AS AMENDED,  
AMONG SEVERAL WISCONSIN  
MUNICIPALITIES WHICH  
JOINTLY RECREATED SAID  
COMMISSION) AMENDING  
SPECIFIC INDUSTRIAL  
PRETREATMENT RULES  
AND REGULATIONS

WHEREAS, the Neenah-Menasha Sewerage Commission is required to enact, maintain and enforce industrial pretreatment rules and regulations in compliance with federal and state laws and regulations; and, accordingly, had previously enacted NMSC Ordinance No. 84-6, on October 9, 1984, amended by NMSC ordinance number 88-1, on March 2, 1988, and further amended by NMSC ordinance number 90-1, on February 26, 1991, and further amended by NMSC Ordinance No. 94-1 on April 26, 1994;

NOW, THEREFORE, the Neenah-Menasha Sewerage Commission does hereby amend the current status of each of the foregoing ordinances by replacing the provisions of the same by enacting this amendatory ordinance to ordain the following new industrial pretreatment and rules and regulations, as approved by the state of Wisconsin, Department of Natural Resources, by letter to the NMSC dated January 8, 2014 (attached hereto and incorporated herein as a fully set forth), to wit:

An Amendment to the Neenah-Menasha Sewerage Commission's Industrial Pretreatment Rules and Regulations existing as NMSC Ordinance 94-1:

Chapter 3, Section 3.03  
(C) (1) is changed to read:

C. NMSC Local Limitations.

1. Local Metal Limits. No discharger shall discharge wastewater containing concentrations and/or mass limitations of the following enumerated materials exceeding the following values:

Material - Concentration  
Cadmium (total) - 0.558 mg/l

Chromium (total) - 15.4 mg/l

Copper (total) - 3.56 mg/l

Mercury (total) - 0.0006 mg/l

(0.0006 mg/L is advisory only the NMSC may allocate the maximum allowable mercury loading (lbs/day) among its sewer users as it deems appropriate.)

The Commission may impose specific mass limitations on Dischargers where deemed appropriate by the Commission.

Chapter 3, Section 3.03  
(C) (2) (a) is changed to read:

2. Local pH Limitations.  
a. Limitation. All discharges shall meet a pH range not less than 5.0 minimum and not more than 11.0 maximum.

IN WITNESS WHEREOF, the NMSC has caused this ordinance to be enacted and to be signed and attested to by its duly authorized officers. This ordinance shall become effective on the date its publication. Passed and adopted by the NMSC, Winnebago County, State of Wisconsin, February, 25, 2014.

Ayes: 5  
Nays: 0

NEENAH-MENASHA  
SEWERAGE  
COMMISSION  
By: /s/Dale Youngquist,  
President  
By: /s/Raymond Zielinski,  
Vice President

State of Wisconsin  
DEPARTMENT OF NATURAL  
RESOURCES  
101 S. Webster Street  
Box 7921

Madison WI 53707-7921

Scott Walker,  
Governor

Cathy Stepp,  
Secretary

Telephone  
608-266-2621

Toll Free  
1-888-936-7463

TTY Access via relay - 711

WISCONSIN  
DEPT. OF NATURAL  
RESOURCES

January 8, 2014

Mr. Dale Youngquist  
President

Neenah Menasha Sewerage Commission  
101 Garfield Ave.

Menasha, WI, 54952-3397

Subject: DNR Approval of Revised Local Limits for the Neenah Menasha Sewerage Commission

Dear Mr. Youngquist:  
The Department has reviewed changes to the Neenah Menasha Sewerage Commission's (NMSC) Sewer Use Ordinance first submitted to the Department on August 28, 2013. These changes included revised local limits for the NMSC. NMSC made further revisions to the proposed local limits as a result of Department comments. The Department notified the public of these revised local limits in a public notice which appeared in the Appleton Post Crescent on Dec. 4, 2013. Neither the Department nor NMSC received any comments regarding the proposed changes.

The Department hereby approves NMSC's revised local limits as public noticed on Dec. 4, 2013. I request that you provide the Department with a copy of the amended sewer use ordinance with revised local limits after its publication.

Sincerely,  
/s/Robert Liska  
Wisconsin Pretreatment  
Coordinator  
(608) 267-7631  
Wisconsin Department of  
Natural Resources, WY/3  
101 S. Webster St., P.O.  
Box 7921  
Madison, WI, 53707 -  
7921

cc: Nan Jameson -  
WDNR Green Bay  
Randall Much - NMSC  
Wastewater Treatment  
Plant  
Laurie Stenson - NMSC  
Wastewater Treatment  
Plant

This attachment is provided for the historical record to show the DNR approved the changes approved by the Amendment of the Ordinance for pretreatment rules following a public hearing.

Amendment to the Neenah Menasha Sewerage Commission's Industrial Pretreatment Rules and Regulations 94-1  
Chapter 3, Section 3.03  
(C) (1) is changed to read:

C. NMSC Local Limitations.

1. Local Metal Limits. No discharger shall discharge wastewater containing concentrations and/or mass limitations of the following enumerated materials exceeding the following values:  
Material - Concentration  
Cadmium (total) - 0.558 mg/l  
Chromium (total) - 15.4 mg/l  
Copper (total) - 3.56 mg/l  
Mercury (total) - 0.0006 mg/l

(0.0006 mg/L is advisory only the NMSC may allocate the maximum allowable mercury loading (lbs/day) among its sewer users as it deems appropriate.)

The Commission may impose specific mass limitations on Dischargers where deemed appropriate by the Commission.

Chapter 3, Section 3.03  
(C) (2) (a) is changed to read:

2. Local pH Limitations.  
a. Limitation. All discharges shall meet a pH range not less than 5.0 minimum and not more than 11.0 maximum.